

Electric Vehicle Integration to Distribution Grid Ensuring Quality Power Exchange

Polly Thomas, Fossy Mary Chacko

M.Tech Student, Dept. of EEE, Saintgits College of Engineering, Pathamuttom, Kerala, India¹Asst. Prof., Dept. of EEE, Saintgits College of Engineering, Pathamuttom, Kerala, India²

Abstract: Now a days, Electric Vehicle (EV) integration to the distribution grid is gradually increasing and is hitting with much power quality issues. This paper presents a smart compactible integration of EV with the distribution grid assuring a quality power. Charging station is the place where an EV integrates with the grid. In this paper, works have been done for a level 3 off-board EV charging infrastructure that can employ multiple EVs which will alleviate the down-time required for vehicle charging. There is a master control to deal with the power exchange between the AC and DC bus (AC-DC Converter Control). The control of individual EV is de-centralized (DC-DC Converter Control). The proposed work looks into two different aspects of EV integration to grid a) Grid to Vehicle mode-G2V (EV charging), b) Vehicle to Grid Mode-V2G (EV discharging Mode) ie, proposing EV as a grid connected distributed generation, c) Simultaneous EV charging and discharging mode ie, G2V & V2G operations. Simulation platform is Matlab. Results show the feasibility of the proposed model during grid integration.

Keywords: Electric vehicle, grid integration, V2G & G2V, quality power,

I. INTRODUCTION

The history of electric vehicle starts in 1868. Since then, studies were going on in utilizing EV as future Vehicle. EV charging station is the place where an EV integrates with the distribution grid. So, expert care has to be given in designing the components in the charging station to ensure a quality grid integration. Also, since the EV has to be user friendly, we have to reduce the charging time. Therefore, the work has been done for a Level 3(200/600V DC, up to 240kW, 400A) [1] EV charging station which ensures fast DC charging.

The integration of EV the grid offers a lot of challenges in power quality. The design of different elements in the proposed model is precisely done to aid quality power exchange. The AC-DC converter employs a control in dq reference frame. The DC-DC converter which aids the EV battery charging/discharging employs constant voltage/constant current strategy. The control strategies tries to fulfill recent IEEE standards 1459-2010 with the objective of maximizing the use/injection of AC power from/into the grid reducing the lower order harmonic factor. In the proposed paper, different aspects of EV integration to grid are analyzed and the results are shown.

II. EV CHARGING STATION DESIGN

The configuration of proposed DC charging station is shown below in Fig 1. The converter is connected to the grid through a LCL filter and transformer. EVs are connected to the slots provided in the DC bus.

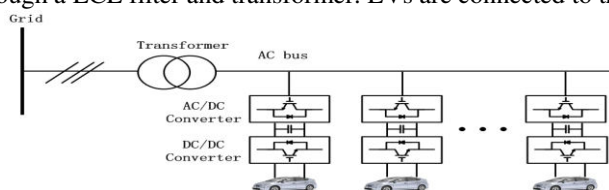


Fig 1: Block schematic of EV charging station.

The charging station rated capacity can be calculated from the below equation.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 2, Special Issue 1, December 2013

$$S_{rated} = \frac{K_{load} N_{slot} P_{EV}}{\cos\phi} \text{ kVA} \quad (1)$$

The charging station rated capacity depends upon the overload factor (K_{load}), number of slots provided (N_{slot}), maximum power of individual EV (P_{EV}), and the power factor ($\cos\phi$).

The upper limit of DC bus nominal voltage is calculated by considering the minimum battery voltage V_{bat}^{min} and the battery charger minimum modulation index m_{min} .

$$V_{dc} \leq \frac{V_{bat}^{min}}{m_{min}} \text{ Volts} \quad (2)$$

A. DC Bus Capacitor

The size of the DC capacitor determines the stability of the DC bus. Since many EVs are connected to the DC bus in the same time, the ripple currents will be very high; thus need a DC bus capacitor. The value can be calculated from the following equation [2].

$$C_{dc} = \frac{S_{rated}}{V_{dc}^2} \frac{2n T \Delta r \cos\phi}{\Delta x} \text{ Farad} \quad (3)$$

The value of the DC bus capacitor depends upon the time period (T) of the AC voltage waveform and allowable DC power (Δr) & bus voltage (Δx) expressed in percentage.

B. Electric Vehicle Battery Selection

The most commonly used EV battery is Li-ion battery. However Nickel Cadmium batteries are also in use. There are some specifications to be considered while selecting the EV battery. They are nominal voltage, cut-off voltage, energy or nominal energy, ampere hour capacity, life of battery, specific energy, specific power, energy density, charge/discharge cycles of battery, internal resistance, environmental factors etc.

C. Electric Vehicle Battery Charger Unit

Below Fig 2 shows the battery charger unit. A buck-boost battery charger [3] unit is considered.

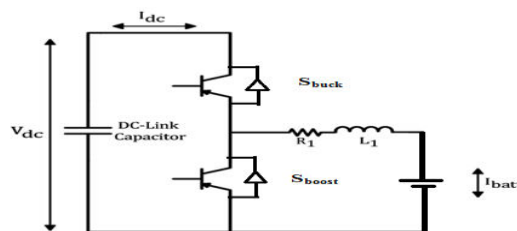


Fig 2: Battery charger unit.

The unit consists of two IGBT switches which performs buck and boost mode of operation under the required control strategy. This unit serves as a DC-DC converter. While boost mode (charging) of operation is executing, the corresponding thyristor switch will be active and the other remains idle and vice versa.

D. Three Phase Converter

The power exchange between AC grid and the DC converter is controlled by the AC-DC converter. It is a bi-directional converter. The switches are IGBTs with gate pulses fed to them to control its operation. Fig 3 shows such an arrangement. The converter is connected to a filter unit.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 2, Special Issue 1, December 2013

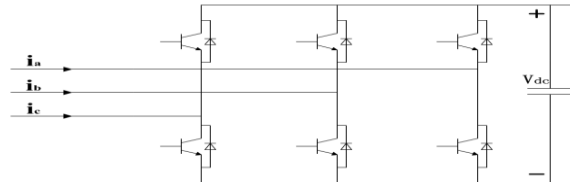


Fig 3: Three-phase converter unit.

E. LCL Filter

Filters are essential to cut out the harmonics in the system. The Fig 4 shows the filter configurations [4] which consist of converter side inductor (L_{con}), filter capacitor (C_f) and grid side inductor (L_{grid}).

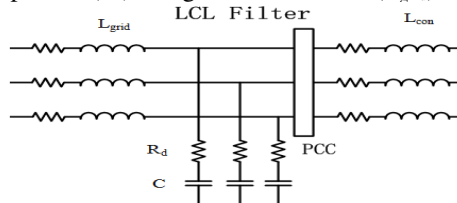


Fig 4: LCL filter configuration.

The design equations [2] for obtaining the values are as follows.

$$L_{con} = \frac{V_{grid}^2 \cdot \sqrt{\frac{\pi^2}{18} \left(\frac{3}{2} - \frac{4\sqrt{3}}{\pi} m_a + \frac{9}{8} m_a^2 \right)}}{S_{rated} \cdot THD \cdot 2\pi f_{sw}} \text{ H} \quad (4)$$

$$C_f \leq \frac{0.05 S_{rated}}{2\pi \cdot f_{grid} \cdot V_{grid}^2} \text{ Farad} \quad (5)$$

$$L_{grid} = \frac{RAF + 1}{RAF \cdot C_f \cdot 2\pi f_{sw}^2} \text{ H} \quad (6)$$

The value of inductor and capacitor depends upon the switching frequency (f_{sw}) of the converter, grid frequency (f_{grid}), modulation index (m_a) of the converter, allowable THD range and ripple attenuation factor (RAF) for respective design equations.

Since there are undamped power oscillations, a damping resistor [6] is included in the circuit to damp out the power oscillations. It can be calculated by the following equation.

$$R_d = \frac{1}{3C_f \omega_{res}} \text{ ohm} \quad (7)$$

Where, ω_{res} is given by,

$$\omega_{res} = \sqrt{\frac{L_{inv} + L_{grid}}{L_{inv} L_{grid} C_f}} \text{ rad/sec} \quad (8)$$

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 2, Special Issue 1, December 2013

Table 1
EV Station Parameters.

Parameters	Values
V_{grid}	20kV ph-ph
f_{grid}	50Hz
Short circuit level	1200MVA
X/R ratio	8
f_{sw}	5000Hz
T	1/50 s
n	0.5
K_{load}	1.1
m_{min}	0.125
$V_{bat_{min}}$	200
$\cos\phi$	0.95
N_{slot}	10
P_{EV}	90kW

III. CONTROLS USED

The control system deals with the control of AC-DC converter and the DC-DC converter. The control system provides a smooth transition from the G2V mode to V2G mode, and simultaneous EV charging and discharging. Converter control

Control in dq reference frame [5], [7] shown in Fig 5 is used to control the converter operation [10]. It consists of voltage and current loops connected in cascade structure. The controller controls the DC bus voltage, alternating current, and the real & reactive power.

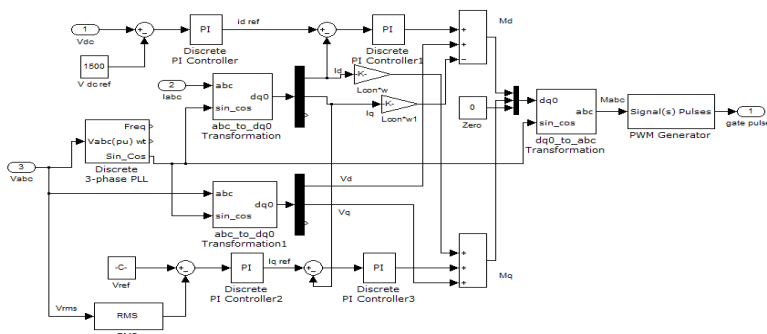


Fig 5: Simulink model of converter control in dq frame.

The terms ωL_{con} and feed forward voltage are given to handle well with transient conditions. Grid synchronization is made possible [8], [9] using a PLL block shown in below Fig 6. Measured three-phase voltage is given as the input to the PLL block.

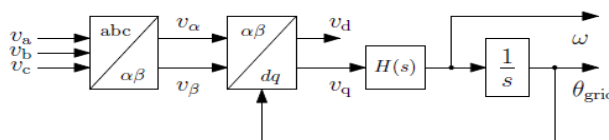


Fig 6: PLL block diagram.

A. EV Battery Charger Unit

Separate control strategies are implemented to control the charging and discharging of the EV battery. The Simulink model for the battery charger circuit is shown below. Since we are considering an off-board DC battery charger unit, the EV battery is directly plugged to the charger circuit as shown in the fig 7.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 2, Special Issue 1, December 2013

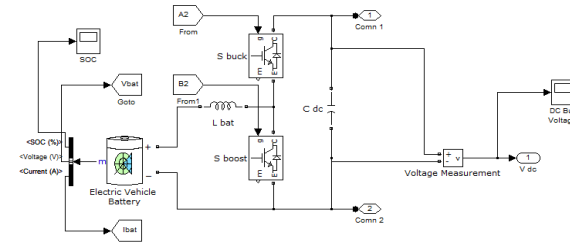


Fig 7: Simulink model of Ev battery charger unit.

1) Constant Current (CC) Strategy

In CC strategy, the battery operates as a constant current source. The converter will operate in boost mode (discharging process).

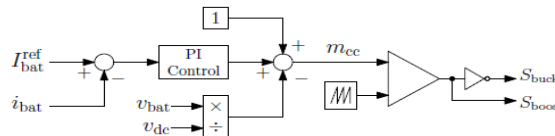


Fig 8: Constant current strategy

2) Constant Voltage (CV) Strategy

In CV strategy, the battery charges under a constant voltage source. The converter will operate in buck mode (charging process).

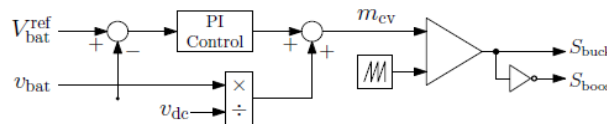


Fig 9: Constant voltage battery charger control

IV. SIMULATION RESULTS

As per the design procedure explained earlier, the Simulink model is implemented in Matlab. The various component blocks used in Simulink modeling is obtained from the SimPower System Library.

A. EV Charging Mode (G2V operation)

Fig 10 shows the simulink model for the EV charging mode. The EV battery charging is controlled in constant voltage strategy.

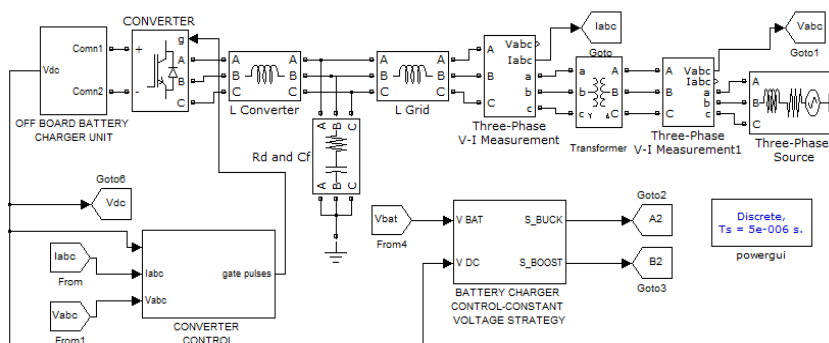


Fig 10: Simulink model for EV charging.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 2, Special Issue 1, December 2013

The results obtained after running the simulation are shown below.

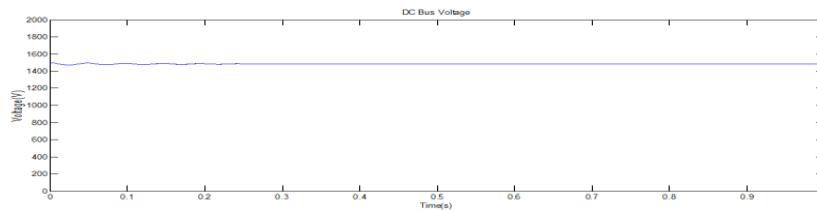


Fig 11: DC bus voltage.

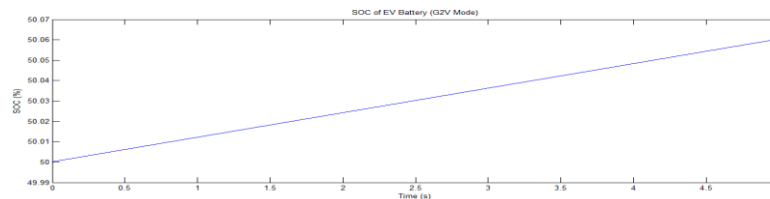


Fig 12: SOC of battery while charging.

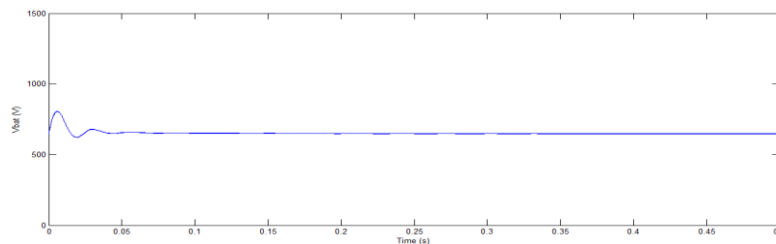


Fig 13: EV battery voltage.

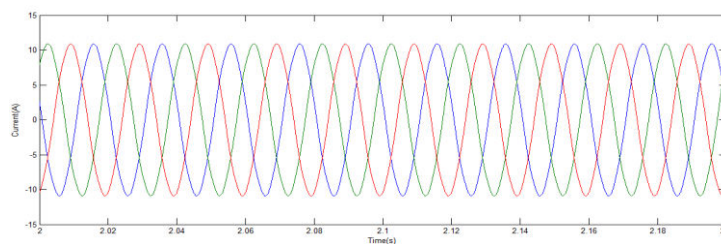


Fig 14: Converter side current waveform.

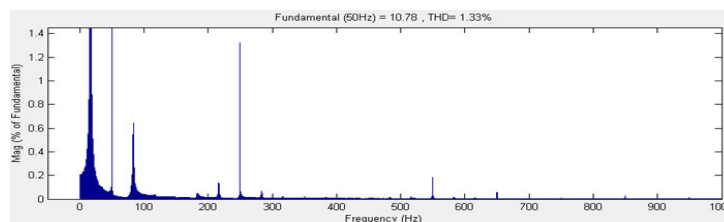


Fig 15: FFT analysis for current waveform.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 2, Special Issue 1, December 2013

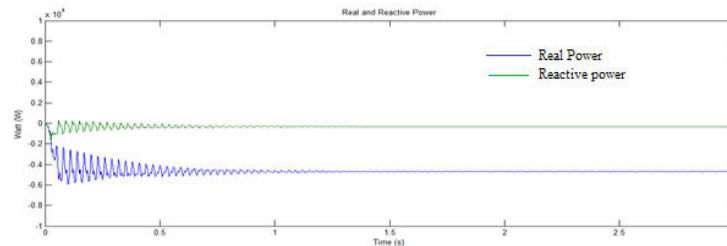


Fig 16: Real and Reactive power.

B. EV Discharging Mode (V2G operation)

Fig 18 shows the Simulink model for the EV discharging mode. The EV battery discharging is controlled in constant current strategy. Also, the feasibility of operating EV as a grid connected distributed generation is illustrated in the results shown below. The EV battery discharging is controlled by constant current control strategy.

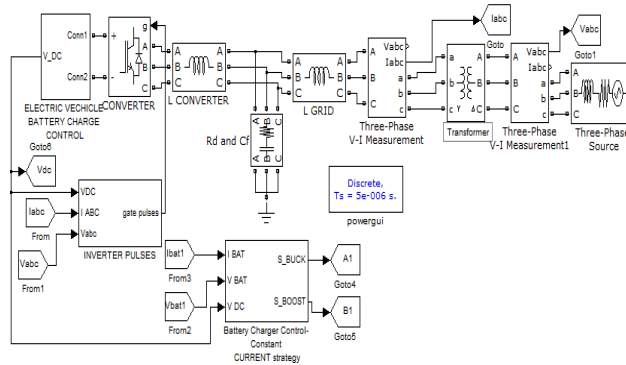


Fig 17: Simulink model for EV discharging

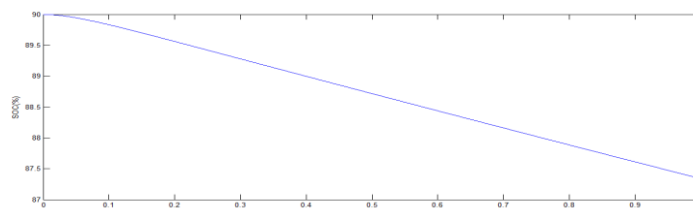


Fig 18: EV battery State Of Charge(SOC).

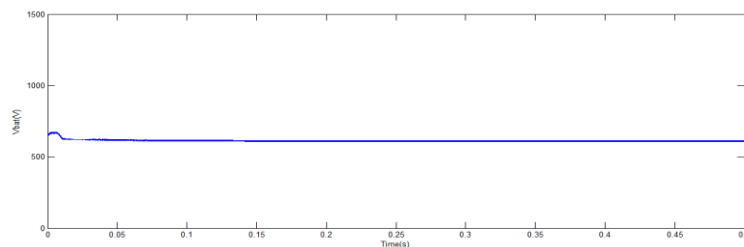


Fig 19: EV battery discharging voltage.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 2, Special Issue 1, December 2013

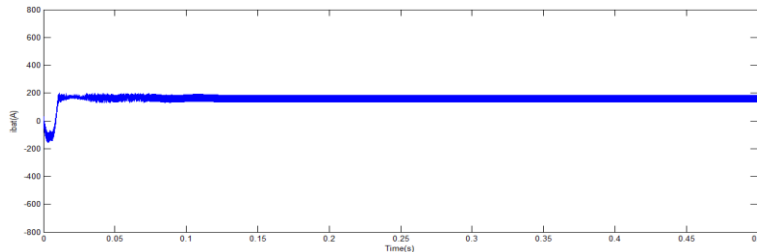


Fig 20: EV battery discharging current.

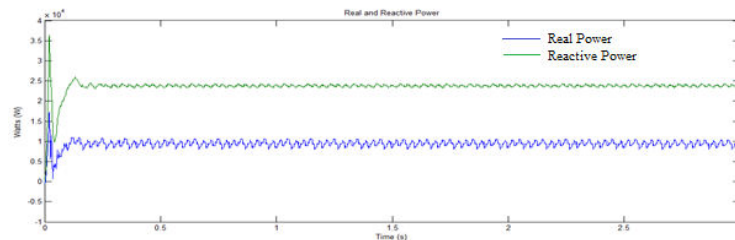


Fig 21: Real and Reactive power.

C. Simultaneous EV Charging and Discharging Mode.

Below Fig 22 shows the simulink model for the grid connected EVs operating both in charging and discharging mode. The EVs are plugged into the respective slots provided for charging/discharging. This scheme of operation enables the V2G and G2V mode at the same time.

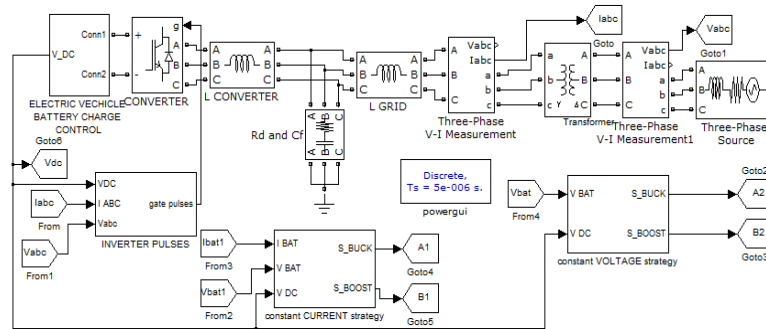


Fig 22: Simulink model of simultaneous EV charging and discharging mode.

The results below show the balanced operation of the proposed scheme.

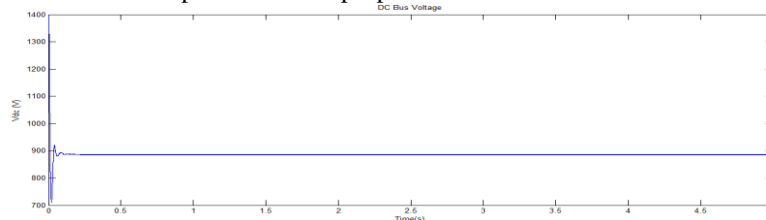


Fig 23: DC bus voltage.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 2, Special Issue 1, December 2013

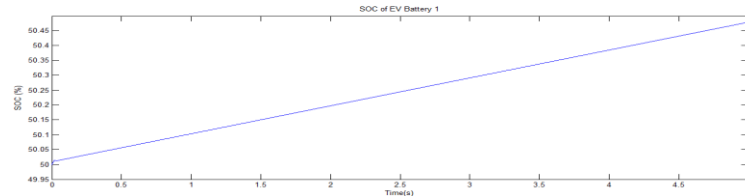


Fig 24: SOC of EV battery 1(charging mode).

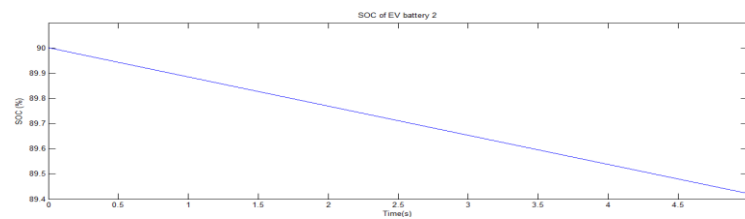


Fig 25: SOC of EV battery 2(discharging mode).

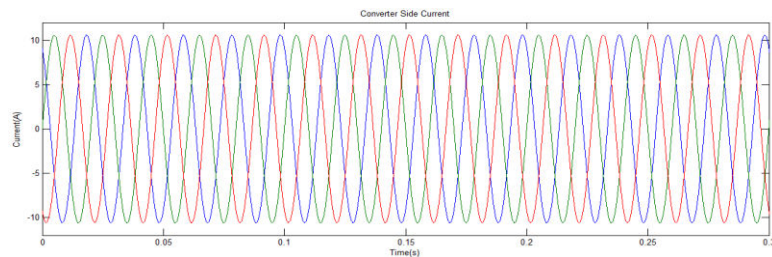


Fig 26: Converter side current.

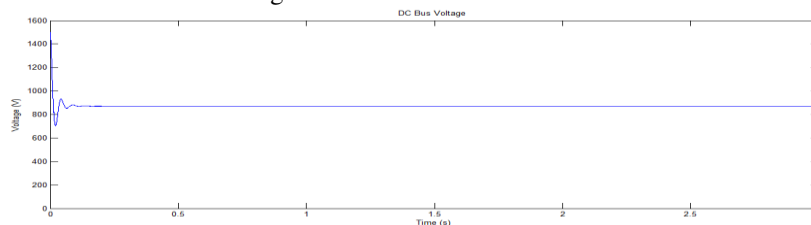


Fig 26: DC bus voltage.

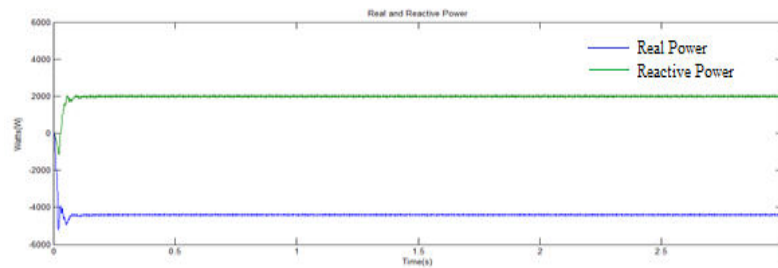


Fig 27: Real and Reactive power.

V. CONCLUSION

A new model for integrating EV to the distribution grid assuring the quality power has been proposed. The modeling equation of each element and the implementation in Matlab/Simulink model is also explained. The feasibility of EV charging mode is illustrated with the help of simulation results. Investigation of using EV as a distributed generation is also done and is shown in results. The results compromise with the IEEE standards 1459-2010 with the objective of maximizing the use/injection of AC power from/into the grid reducing the lower order harmonic factor and load unbalance.



International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 2, Special Issue 1, December 2013

REFERENCES

- [1] <http://www.sae.org/smartgrid/chargingspeeds.pdf>. Arancibia A., Strunz K., "Modeling of electric vehicle charging station for fast DC charging" Electric Vehicle Conference (IEVC), 2012 IEEE International. Karlsson P. Svensson J., "DC bus voltage control for distributed power systems", Power Electronics, IEEE Transaction on Vol.18, no.6, pp. 1405-1412, nov 2003.
- [2] Mohan N. "First course on Power Electronic converters and Drives" Minneapolis, USA. ISBN 0-9715292-2-1
- [3] Min-Young Park, Min-Hun Chi, Jong-Hyoung Park, Heung-Geun Kim, "LCL filter for grid connected PCS using total harmonic distortion and ripple attenuation factor" Power Electronics conference (IPEC), 2010 International, vol no., pp.1688-1694, 21-24 June 2010.
- [4] Yazdani, A. Iravani R., "Voltage sourced converters in Power System modeling, control and application" John Willey and sons, 2009-Technology and Engineering.
- [5] Wessels C., Dannehl J, and Fuchs F.W., "Active damping of LCL filter resonance based on virtual resistor for PWM rectifiers - stability analysis with different filter parameters" in Power Electronics Specialist Conference, 2008.p. C.D.
- [6] Gabe, I. J., Montagner, V. F., and Pinheiro, H., "Design and implementation of a robust current controller for vsi connected to the grid through an lcl filter," *Power Electronics, IEEE Transactions on*, vol. 24, no. 6, pp. 1444–1452, June 2009.
- [7] A. V. Timbus, M. Liserre, R. Teodorescu, and F. Blaabjerg, "Synchronization methods for three phase distributed power generation systems. An overview and evaluation," in *Proc. IEEE PESC*, 2005, pp. 2474–2481.
- [8] M. C. Benhabib and S. Saadate, "A new robust experimentally validated phase-locked loop for power electronic control," *EPE J.*, vol. 15, no. 3, pp. 36–48, Aug. 2005.
- [9] Mohan, N. Undeland, T. Robbins, W. "Power Electronics Converters, Applications, and Design" ISBN 0-471-22693-9.

BIOGRAPHY



Fossy Mary Chacko -Received B-Tech in Electrical & Electronics Engineering from University of Kannur, India. She received M.Tech degree in Industrial drives and control from RIT ,Pampadi India . She has been working in the EEE department of SAINTGITS College of Engineering as Asst.Professor for 8 years.



Polly Thomas - Received B-Tech in Electrical & Electronics Engineering from St.Josephs College of Engineering and Technology, Palai Kerala under the Mahatma Gandhi University in 2010 .Currently pursuing M-Tech in Power Systems under the Mahatma Gandhi University.