



Power Factor Control of PV Generators in Local Distribution Networks using Fuzzy Logic Concept

RA. Shalwala¹, SA. waheeb²

¹Department of Electrical Engineering, College of Engineering and Islamic Architecture, Umm AlQura University, Makkah 21955, Saudi Arabia.

²Department of Engineering Sciences, Community College, Umm AlQura University, Makkah 21955, Saudi Arabia.

ABSTRACT: One of the most important operational requirements for any electrical power network for both distribution and transmission level is voltage control. Many studies have been carried out to improve or develop new voltage control techniques to facilitate safe connection of distributed generation. In Saudi Arabia, due to environmental, economic and development perspectives a wide integration of photovoltaic (PV) generation in distribution network is expected in the near future. This development in the network may cause voltage regulation problems due to the interaction with the existing conventional control system. In a previous paper [1] a control system has been described using a fuzzy logic control to set the on-line tap changer for the primary substation. In this paper a new control system is proposed for controlling the power factor of individual PV invertors based on observed correlation between net active and reactive power at each connection. A fuzzy logic control has been designed to alter the power factor for the remote invertors from the secondary substation to keep the feeder voltage within the permissible limits. In order to confirm the validity of the proposed method, simulations are carried out for a realistic distribution network with real data for load and solar radiation. Results showing the performance of the new control method are presented and discussed.

KEYWORDS: Grid connected PV system, Dnetwork, Power factor, Fuzzy logic, Control.

I. INTRODUCTION

This paper presents an approach for solving the feeder voltage regulation problem in a local manner, with the goal of fulfilling the plug-and-play feature desired by manufacturers and regulatory bodies. The plug-and-play feature will enable customers to simply connect their PV systems to the distribution feeder, and through a fuzzy logic control (FLC) the power flow from the PV system through the invertors will be controlled to help maintain the feeder voltage level within limits at minimum cost. The chapter paper by the proposed controller objectives. The proposed controller design is based on FLC and the architecture is then presented. Test results of this system are shown to prove that the proposed controller can successfully regulate the voltage of a distribution feeder with PV systems connected to it. Finally the interaction between two controllers at the same feeder has been investigated and a simulation is carried out under MATLAB /Simulink environment to evaluate the stability of the control algorithm.

II. CONTROL OF THE REACTIVE POWER OF PV GENERATION USING FLC

Consider a voltage source $V_S \angle \delta$ connected to a utility grid $V_G \angle 0^\circ$ through a coupling impedance $Z=R+jX$, as shown in Figure1.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 5, Issue 5, May 2016

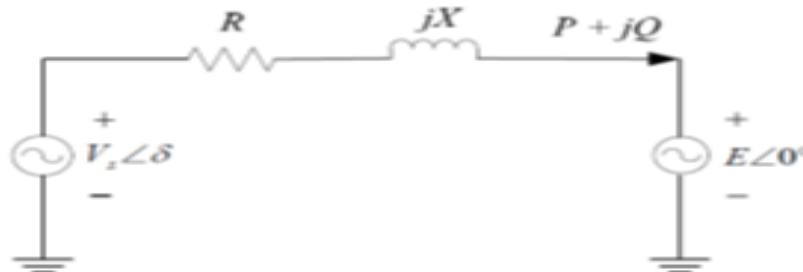


Figure 1: Power flow between a voltage source and utility grid.

The real and reactive power delivered to the utility grid is [2]:

$$P = \frac{V_G V_S}{Z} \cos(\theta_Z - \delta) - \frac{V_G^2}{Z} \cos(\theta_Z) \quad (1)$$

$$Q = \frac{V_G V_S}{Z} \sin(\theta_Z - \delta) - \frac{V_G^2}{Z} \sin(\theta_Z) \quad (2)$$

From equation 1 and equation 2, it is clear that the real and reactive power delivered to the utility grid are completely determined by the amplitude and angle of the sending voltage source, i.e. the output voltage of the inverter. On the other hand, the values of V_S and δ can be determined from equation 3 and equation 4 if the desired values of real and reactive power are given.

$$V_S = \left[\frac{Z^2}{V_G^2} (P^2 + Q^2) + V_G^2 + 2PZ \cos(\theta_Z) + 2QZ \sin(\theta_Z) \right]^{1/2} \quad (3)$$

$$\delta = \theta_Z - \cos^{-1} \left[\frac{ZP}{V_G V_S} + \frac{V_G}{V_S} \cos(\theta_Z) \right] \quad (4)$$

When the PV generator is connected to the radial feeder, its active power export reduces the power flow from the secondary substation. This causes reduction in the voltage drop along the feeder. If the generator's power export is larger than the feeder load, power flows from the generator to the primary substation and this causes a voltage rise along the feeder.

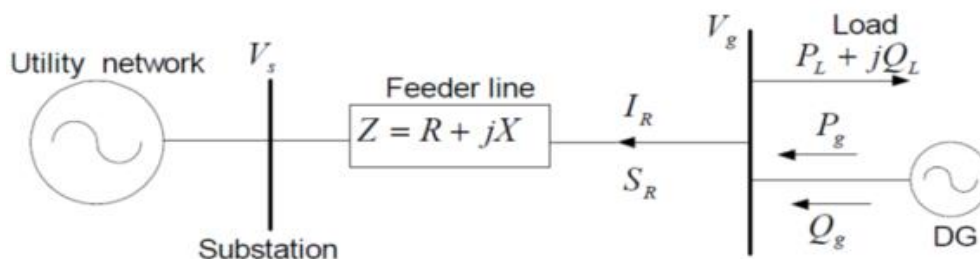


Figure 2: Utility network with DG.

equation 1 describes how the voltage level is changed at the point of connection of the DG. The active power produced by DG increase the voltage, whereas the reactive power can further increase or reduce it depending on the type of DG technology. The PV generator can generate or absorb reactive power depending on the operating power factor of the inverter. These outcomes, in combination with the system's R/ X ratio or distribution network characteristics and load profiles, determine the increase in voltage level at the connection point due to power production of the PV generator.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 5, Issue 5, May 2016

The inverter can only dispatch or consume the reactive power if its apparent power capability (S) exceed the instantaneous power generated by the connected PV panels. The range of allowable reactive power consumption or generation is given by equation5.

$$|Q| \leq \sqrt{S^2 - P_{PV}^2} \quad (5)$$

In this study the inverter is assumed to be operating up to 0.9 lagging power factor.

III. DESIGN OF FL POWER FACTOR CONTROLLER FOR INVERTER

According to equation.3 the active power generated by the PV and the active power consumed by the load will be used as an input to the fuzzy logic controller. Also, the distance from the secondary substation will be used as third input. The operating power factor for the inverter will be the output of the controller. The customer feeder I9 in the typical model of the distribution network in Figure7 will be considered for investigating the behavior of the controller under different conditions of load and solar irradiation. Figure 3 shows the step by step design for the FL power factor controller for inverter.

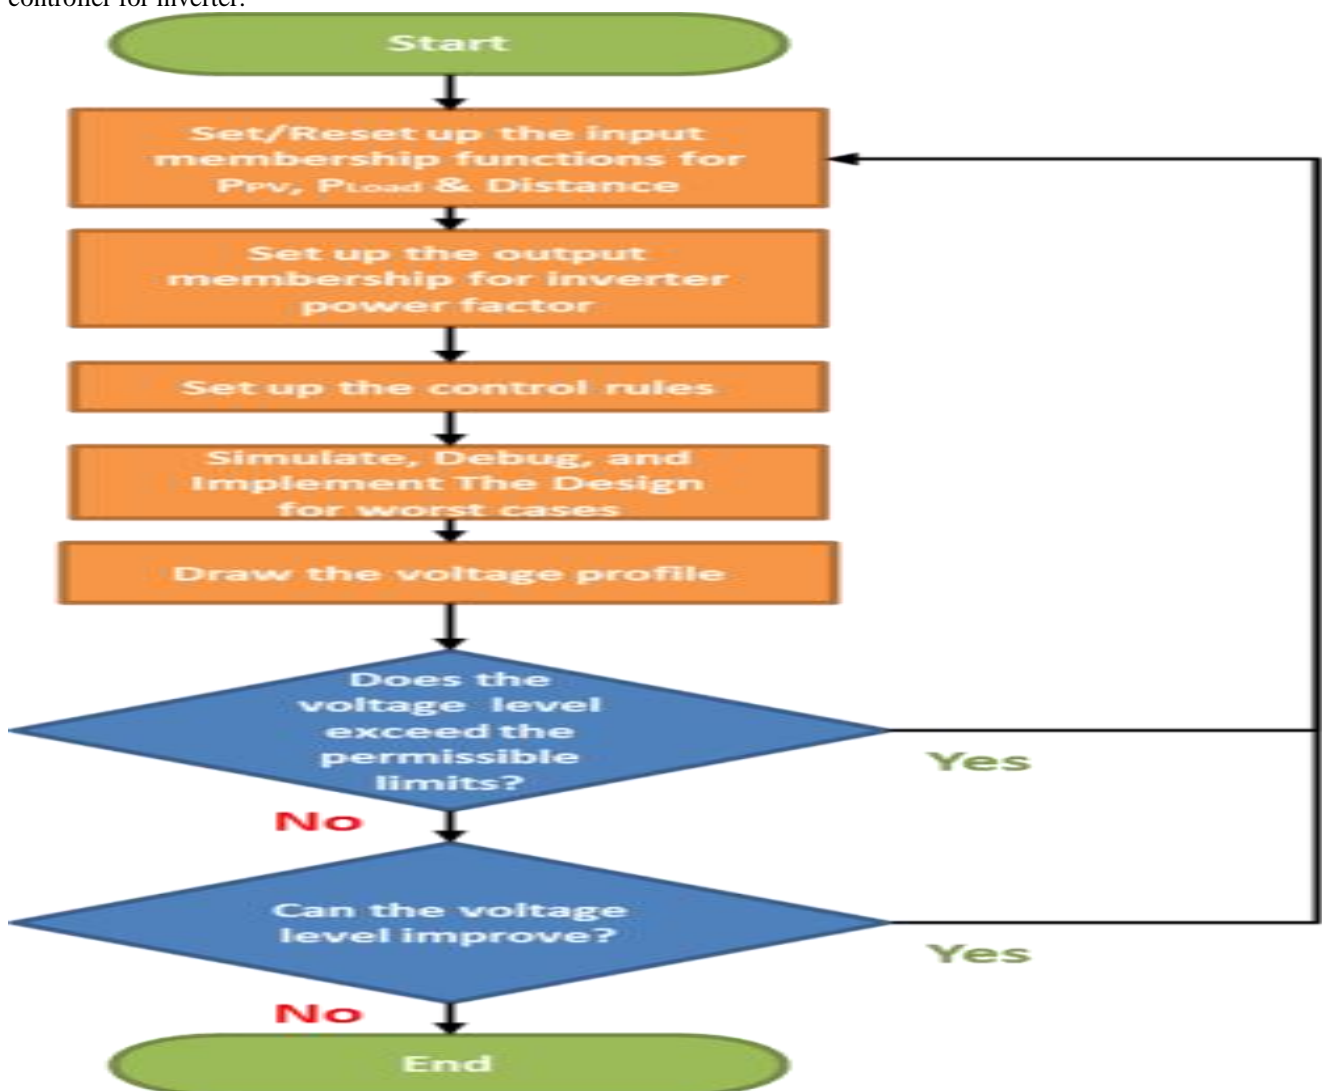


Figure 3: Step by step design for the FL power factor controller for inverter.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 5, Issue 5, May 2016

3.1. Input Membership Functions

a) Output power of PV (P_{PV}):

The output power of PV generator membership is represented by a range of 0 kW to 40 kW.

MF		Approximate range (kW)
L	Low	0-9
M	Medium	Sep-24
H	High	24-40

Table 1: Membership function P_{PV} Range.

The triangular membership function is used to take advantage of the simplicity of the system and reduce the running time of the program for the whole integrated fuzzy system.

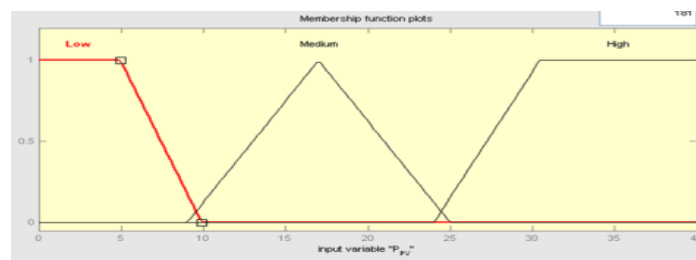


Figure 4: Input membership function P_{PV}.

b) Load power P_L:

The load power of each node membership is represented by a range of 0 kW to 20 kW.

MF		Approximate range (kW)
L	Low	0-7.5
M	Medium	7.5-16.5
H	High	16.2-22

Table 2: Membership function P_L Range.

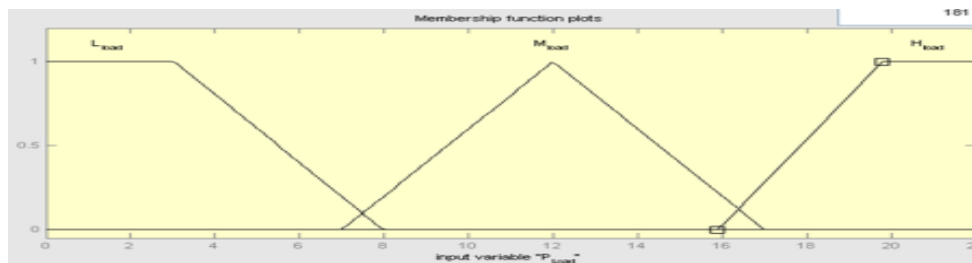


Figure 5: Input membership function P_L.

c) Distance from secondary sub-station:

The distance for each node from substation membership is presented by a range 0m to 200 m according to the base model.

MF		Approximate range (m)
N	Near	0-50
M	Medium	50-100
F	Far	100-200

Table 3: Membership function D range.

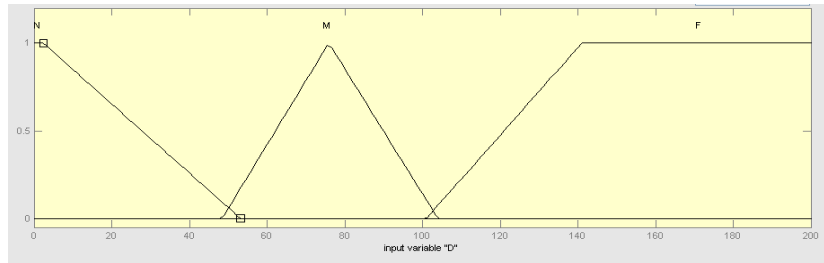


Figure 6: Input membership function D.

3.2. Output Membership Function

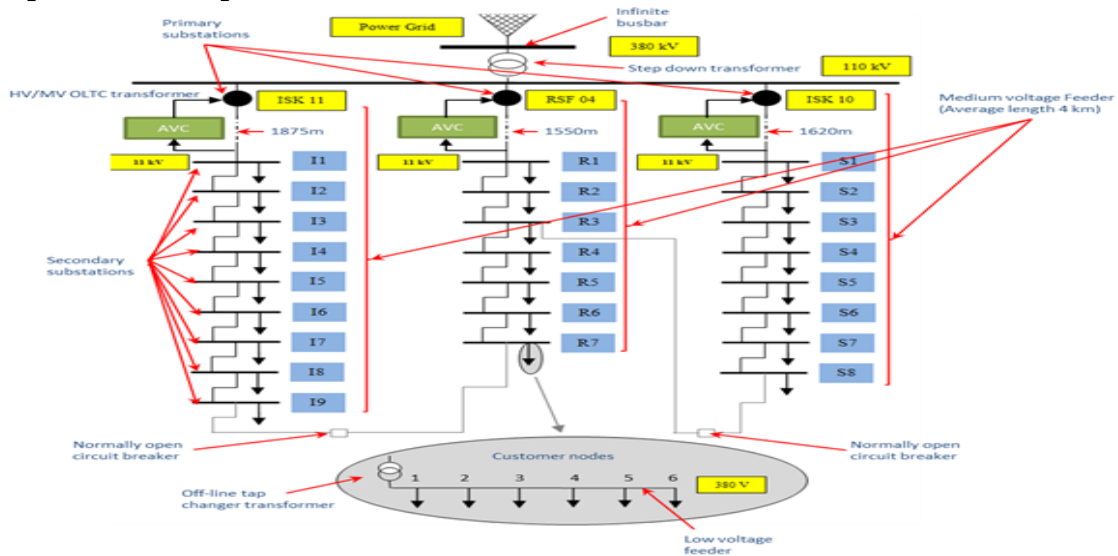


Figure 7: Typical distribution network.

Overcoming the voltage rise issue at any node of the feeder with PVs can be done by operating the PV generators at 0.9 lagging power factor. This value will be used for the far nodes in the worst case scenario with maximum PV and no load. Figure 8 shows the voltage profile along the I9 feeder with maximum PV at node 5 and 6 and no load at all nodes.

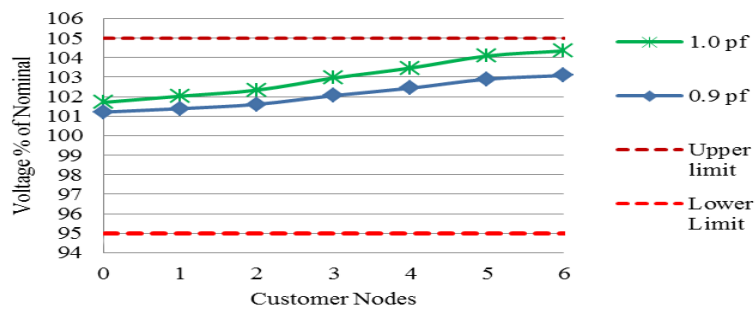


Figure 8: Voltage profile of I9 (No load & Max PV at node 5 & 6).

For the medium distance node from the secondary substation 0.95 lagging power factor will be used. Figure 9 shows the voltage profile along the I9 feeder with maximum PV at node 3 and 4 and no load at all nodes.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 5, Issue 5, May 2016

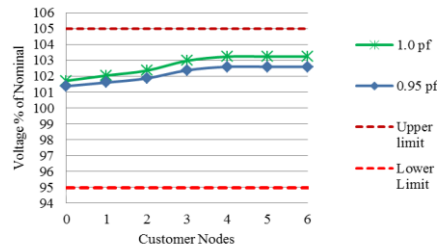


Figure 9: Voltage profile I9 (No load & Max PV at node 3 & 4).

Finally, for the near nodes from the substation the inverter will be kept uncontrolled which means that the inverter operates at unity power factor for all cases. This makes this proposed method cheaper. Figure 10 shows the voltage profile along the I9 feeder with maximum PV at node 1 and 2 and no load at all nodes.

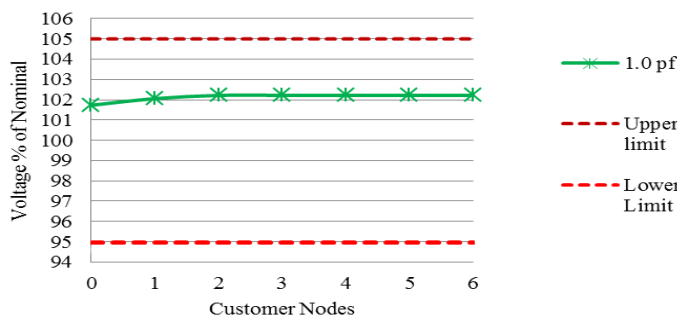


Figure 10: Voltage profile I9 (No load & Max PV at node 1 & 2).

In order to force the output of the controller to choose one of these lagging power factors (0.9 and 0.95) or keep it working at unity power factor a membership function with a single spike is used. Figure 11 shows the output membership function for the power factor set.

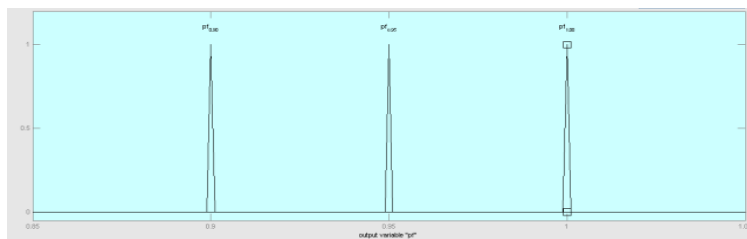


Figure 11: Output membership function lagging power factor set.

3.3. The control rules

The possible combination between the 3 inputs situations will give a total number of 27 rules as there are 3 situations for each input. However, because the near nodes will be uncontrolled the total number of rules reduces to 18 rules. The desired power factor will be selected logically for each situation. Table.4 shows the fuzzy rules to set up the power factor of the inverter at customer in the middle range distance from substation (50-100m).

	PV		
Load	Low	Medium	High
Low	1.0	1.0	0.95
Medium	1.0	1.0	1.0
High	1.0	1.0	1.0

Table 4: fuzzy rule base for nodes in medium range distance.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 5, Issue 5, May 2016

Table.5 shows the fuzzy rules to set up the power factor of the inverter at customer in the far distance from substation (100-200m).

	PV	Low	Medium	High
Load				
Low		1.0	0.95	0.90
Medium		1.0	1.0	0.95
High		1.0	1.0	1.0

Table 5: fuzzy rule base for nodes in far range distance.

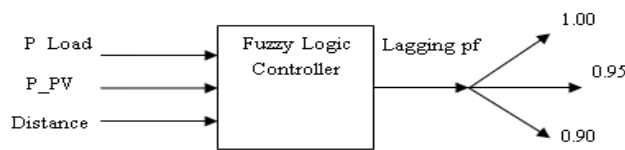


Figure 12: shows the proposed FLC for each generator.

3.4. Simulations and results

The steady-state solution has been investigated to check the behavior of the proposed controller at worst case scenarios. For each case the selected data for the load power, the power generated by PV and the distance from the secondary substation are used as inputs for the fuzzy system in MATLAB Simulink environment. The output of this system is used to set the operating pf for generators at each node in I9 feeder by using the ETAP software package. Then, the simulation is run to get the voltage level at each node with the fuzzy logic decision and rerun when the generators are kept uncontrolled. After that, the readings of voltages are taken to an excel spread sheet to draw the voltage profile of both cases:

1. Un-controlled PV inverter (ie. 1.0 pf).
2. Controlled PV inverter by FLC.

Table.6 shows all possible worst case scenarios that can be happen at the feeder.

Node	P _{Load}			P _{PV}		
	1,2	3,4	5,6	1,2	3,4	5,6
Case 1	No	No	No	Max high	Max high	Max high
Case 2	No	No	Min medium	Max high	Max high	Max high
Case 3	No	Min medium	Min medium	Max high	Max high	Max high
Case 4	No	Min medium	Min high	Max high	Max high	Max high
Case 5	No	No	No	Max high	Max high	Max medium
Case 6	No	No	No	Max high	Max medium	Max medium
Case 7	No	No	No	Max high	Max high	Max low
Case 8	No	No	No	Max high	Max medium	Max low

Table 6: Worst case scenarios.

Figure 13 to Figure 20 show the results for all worst case scenarios.

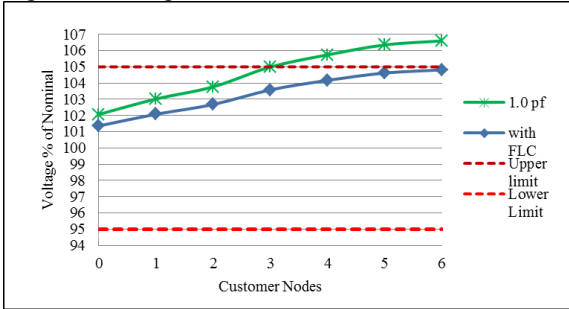


Figure 13: Case 1: Voltage profile I9 (No load & Max high PV at all node).

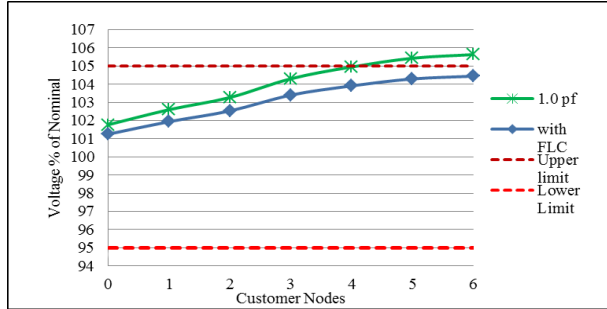


Figure 14 Case 2: Voltage profile I9 (Min medium load & Max high PV at node 5, 6 and No load & Max high PV at node 1, 2, 3, 4)

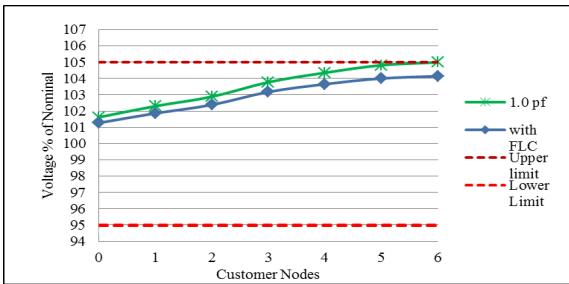


Figure 15 Case 3: Voltage profile I9 (Min medium load & Max high PV at node 3, 4, 5, 6 and No load & Max high PV at node 1, 2)

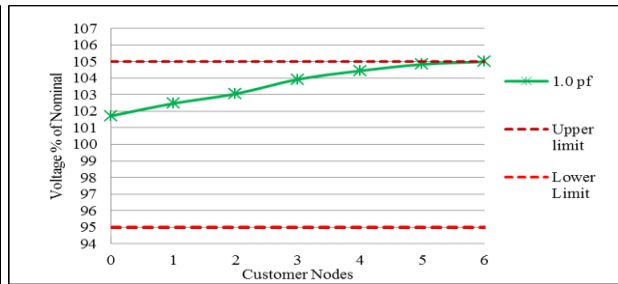


Figure 16 Case 4: Voltage profile I9 (Min high load & Max high PV at node 5, 6 and Min medium load & Max high PV at node 3, 4 and No load & Max high PV at node 1, 2)

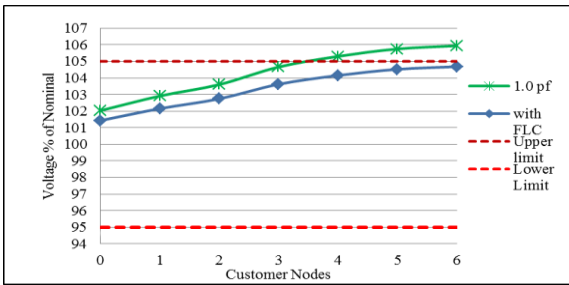


Figure 17 Case 5: Voltage profile I9 (No load & Max medium PV at node 5, 6 and No load & Max high PV at node 1, 2, 3, 4)

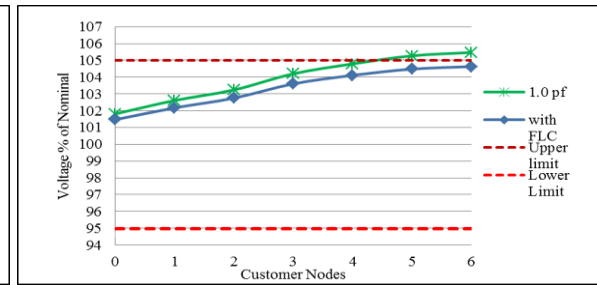


Figure 18 Case 6: Voltage profile I9 (No load & Max medium PV at node 3, 4, 5, 6 and No load & Max high PV at node 1, 2)

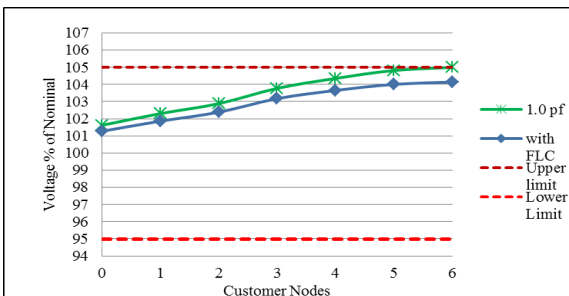


Figure 19 Case 7: Voltage profile I9 (No load & Max low PV at node 5, 6 and No load & Max high PV at node 1, 2, 3, 4)

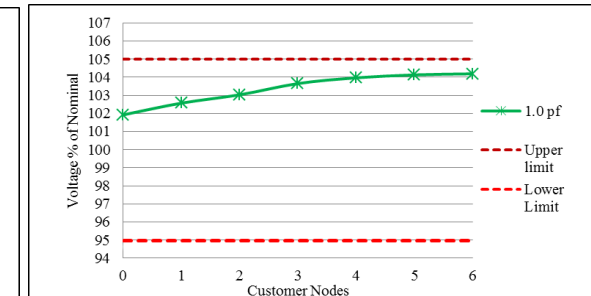


Figure 20 Case 8: Voltage profile I9 (No load & Max low PV at node 5, 6 and No load and Max medium PV at node 3, 4 and No load & Max high PV at node 1, 2)

The previous figures show clearly the ability of the proposed FLC to keep the voltage level for all nodes within the permissible level. Also, the voltage profile can be brought down for case 4 by resetting the range of the input memberships for medium load if this desired by the network operator. As the proposed FLC would manage to keep the voltage between the limits in all worst cases, it will be valid for all other possible scenarios, meaning that it offers a plug and play option for each customer.

IV. STABILITY ASSESSMENT FOR THE PROPOSED FLC

4.1. MATLAB/Simulink model

In order to check the stability of the previous proposed controller for each generator on a same feeder and check the interaction between them, a dynamic simulation is needed with at least two controllers at the same feeder. In this section the MATLAB/Simulink with powers tool box will be used to investigate this issue. The same model designed in [3] to control the inverter for fuel cells by setting the required active and reactive power will be used. Figure 21 shows the block diagram for the controller of the inverter.

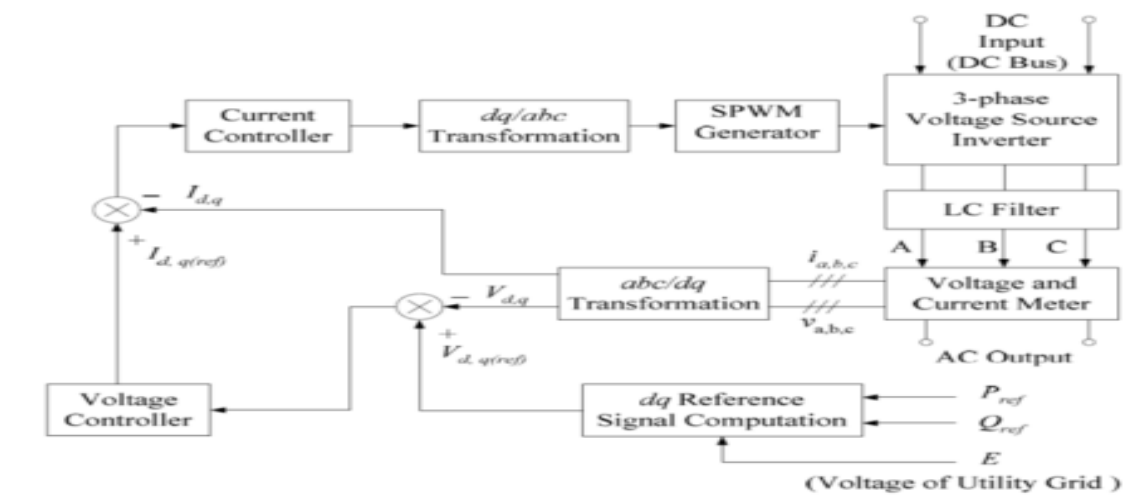


Figure 21: Block diagram of the controller for the inverter [3]

In Figure 21, the “dq Reference Signal Computation” block, which is based on equation 3 and equation 4, calculates the magnitude and angle of the filtered output voltages of the inverter and then converts them into dq voltage reference signals. The “abc/dq Transformation” block takes the current and voltage values (in abc coordinate) from the voltage and current meters and converts them into dq values. The outer voltage controller takes the error signals between the actual output voltage in dq frame ($V_{d,q}$) and the reference voltage ($V_{d,q(ref)}$) and generates the current reference signals ($I_{d,q(ref)}$) for the current control loop. The inner current controller produces the dq control signals, which are converted back into the control signals in abc coordinates through the “dq/abc Transformation” block. These control signals are used to modulate the sinusoidal pulse width modulation (SPWM) pulse generator to produce the proper pulses for the inverter switches, which control the inverter output voltage.

However, the desired active and reactive power is derived by the proposed FLC. The stability issue for such a system appears because the value of the voltage at the node of connection is taken into account for setting the reactive output power of the inverter. At the same time the voltage level at the node of connection is changed by the total power penetration from the inverter as has been shown before. So, the main objective of this section is to investigate the behaviour of two controllers at two nodes in the same feeder while changing the load and the power from the PV generator. Nodes 5 and 6 of 19 feeder have been taken into consideration with maximum power integration. The load at node 5 will be changed from low to high while the load at node 6 goes from high to low at the same time. All other nodes in the feeder are kept constant and without PV integration. Figure 22 shows the simulation model for each inverter in MATLAB/Simulink.

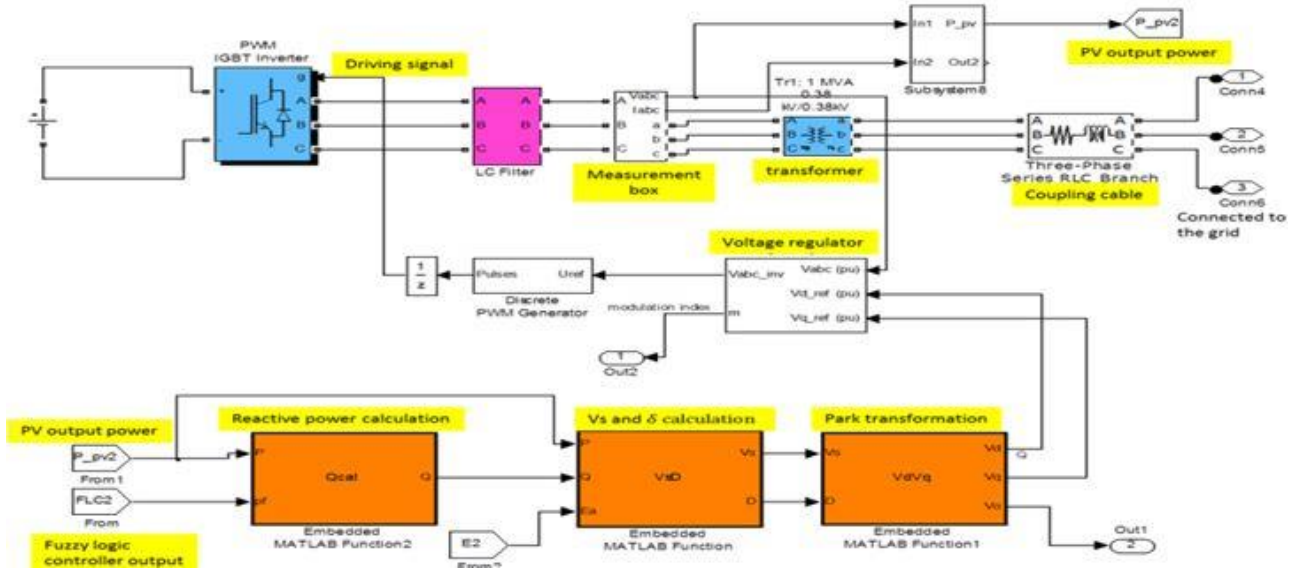


Figure 22: Controlled inverter.

The output of the fuzzy logic controller (power factor) and the total power generated by PV will be used to calculate the required reactive power by using an embedded function, Qcal in MATLAB/Simulink. Another embedded function, VsD used to calculate V_S and δ based on equation 3 and equation 4. Then reference values for the voltage control loop ($V_{d,q}(ref)$) are calculated by Park's transformation. Also, the voltage regulator includes the current control loop to set up the pulses for the inverter to deliver the required active and reactive power to the system. Figure 23 shows the simulation model for the feeder I9 with the FLC for node 5 and 6.


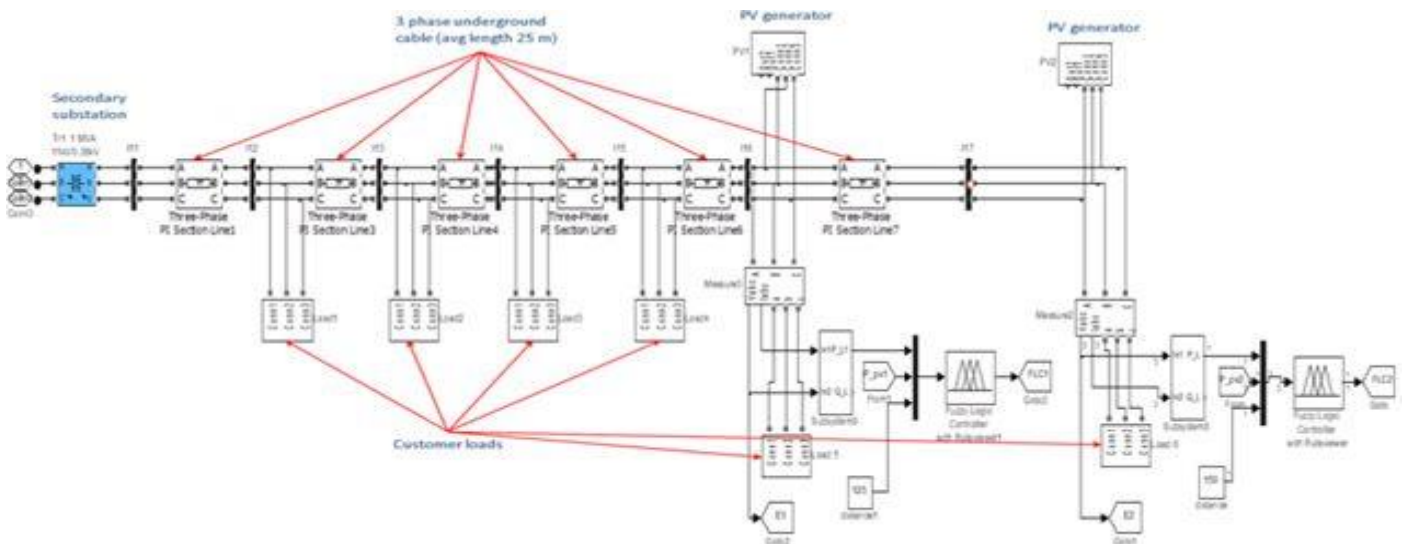


Figure 23: Simulation model for I9 feeder.

4.3. Results of simulations:


Figure 24 and Figure 25 shows the load and the FLC decision at node 5 and 6. The PV generators remain at maximum value during the simulation for both nodes.

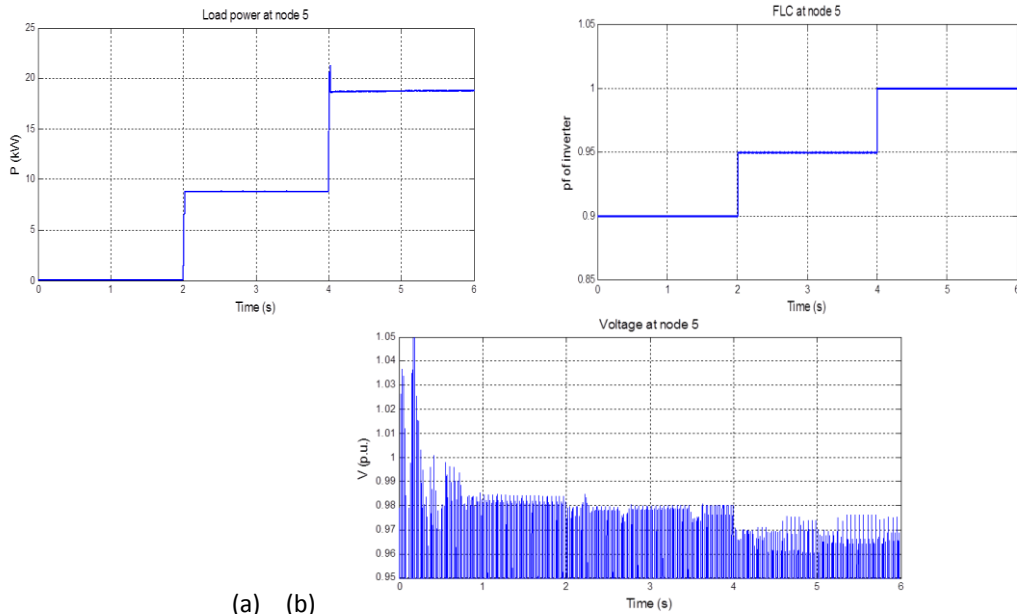

(a) (b)

(c)

Figure 24: Node 5 (a) FLC decision (b) Load power (c) Line Voltage.

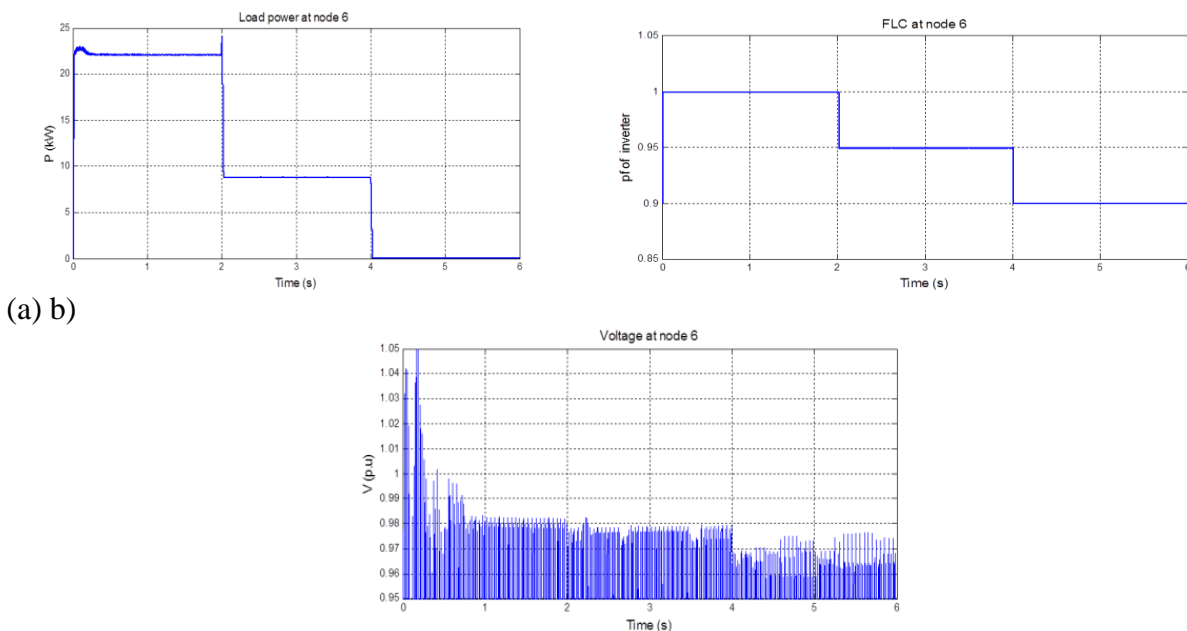

(a) (b)

(c)

Figure 25: Node 6 (a) FLC decision (b) Load power (c) Line Voltage.

The results show that the decision of each FLC will not be affected by the situation of the other one and there is no interaction between them. This means that there is no need for any type of coordination between the local controllers. This gives a very good advantage for this technique comparing with other solutions that depends on coordination and communication network.



ISSN (Print) : 2320 – 3765
ISSN (Online): 2278 – 8875

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 5, Issue 5, May 2016

V. CONCLUSION

This paper has presented a novel technique to regulate the voltage along a distribution feeder with PV integration. A local controller for each PV generator is designed using FL concepts to set the rred consumption of reactive power for each inverter. The steady-state results have been presented which show the ability of the proposed control to handle the problem of voltage rise. Also, it offered a plug and play option for all customers on the feeder. Finally, the stability of the system has been assessed using MATLAB/Simulink with powers tool box. The simulation results show that the system with FLC of the power factor responds in a stable manner to dynamic changed in load and PV power

REFERENCES

- [1] RA Shalwala, JAM Bleijs, Voltage control scheme using Fuzzy Logic for residential area networks with PV generators in Saudi Arabia, in Innovative Smart Grid Technologies (ISGT), 2011, 1-6.
 - [2] JD Glover, MS Sarma, Power system analysis and design. Boston: PWS Pub., 1994.
- MH Nehrir, C Wang, Modeling and control of fuel cells distributed generation applications (2009).